DATASHEET - BBAOR-25



Busbar adapter, 90 mm, 25 A, DIN rail: 1

2465048

Part no. BBAOR-25 Catalog No. 101453 Alternate Catalog BBAOR-25

No.

EL-Nummer

(Norway)



Delivery program

| Accessories | | | Busbar adapters |
|---------------------------|----------------|----------|--|
| | | | For fitting to flat Cu-busbars with 60 mm between busbar centres, suitable for 5 mm and 10 mm busbar thickness Rated operational current 25 A For reversing starters |
| For use with | | | Busbar adapter PKZ0, PKE |
| Rated operational voltage | U _e | V | 690 |
| Rated operational current | l _e | Α | 25 |
| Terminal capacity | | | AWG 12 (4 mm²) |
| Adapter width | | mm | 90 |
| Adapter length | | mm | 200 |
| DIN rail | | Quantity | 1 |
| Adapter width | | mm | 90 |
| For use with | | | PKZM0, PKE + 2 x DILM7-01 PKZM0, PKE + 2 x DILM9-01 PKZM0, PKE + 2 x DILM12-01 MSC-R-0,25-M7 MSC-R-12-M12 |

Notes In combination with individual components PKZM0, PKE, and DILM DOL reversing starter use PKZM0-XRM12. Completely mounted and tested combination with MSC-R...

Design verification as per IEC/EN 61439

| Design verification as per 120/214 01703 | | | |
|--|-------------------|----|--|
| Technical data for design verification | | | |
| Rated operational current for specified heat dissipation | In | Α | 25 |
| Heat dissipation per pole, current-dependent | P _{vid} | W | 0 |
| Equipment heat dissipation, current-dependent | P _{vid} | W | 1.9 |
| Static heat dissipation, non-current-dependent | P _{vs} | W | 0 |
| Heat dissipation capacity | P _{diss} | W | 0 |
| Operating ambient temperature min. | | °C | -25 |
| Operating ambient temperature max. | | °C | 55 |
| IEC/EN 61439 design verification | | | |
| 10.2 Strength of materials and parts | | | |
| 10.2.2 Corrosion resistance | | | Meets the product standard's requirements. |
| 10.2.3.1 Verification of thermal stability of enclosures | | | Meets the product standard's requirements. |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat | | | Meets the product standard's requirements. |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects | | | Meets the product standard's requirements. |
| 10.2.4 Resistance to ultra-violet (UV) radiation | | | Meets the product standard's requirements. |
| 10.2.5 Lifting | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.6 Mechanical impact | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.7 Inscriptions | | | Meets the product standard's requirements. |
| 10.3 Degree of protection of ASSEMBLIES | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.4 Clearances and creepage distances | | | Meets the product standard's requirements. |
| 10.5 Protection against electric shock | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.6 Incorporation of switching devices and components | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.7 Internal electrical circuits and connections | | | Is the panel builder's responsibility. |
| 10.8 Connections for external conductors | | | Is the panel builder's responsibility. |

| 10.9 Insulation properties | |
|--|--|
| 10.9.2 Power-frequency electric strength | Is the panel builder's responsibility. |
| 10.9.3 Impulse withstand voltage | Is the panel builder's responsibility. |
| 10.9.4 Testing of enclosures made of insulating material | Is the panel builder's responsibility. |
| 10.10 Temperature rise | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating | Is the panel builder's responsibility. The specifications for the switchgear must be observed. |
| 10.12 Electromagnetic compatibility | Is the panel builder's responsibility. The specifications for the switchgear must be observed. |
| 10.13 Mechanical function | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed. |

Technical data ETIM 7.0

Low-voltage industrial components (EG000017) / Busbar adapter (EC001531)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Busbar trunking system (LV circuitry) / Busbar adapter (low-voltage switching technology) (ecl@ss10.0.1-27-37-03-04 [ACN951011])

| Mounting rail armament | | 1 mounting rail |
|-----------------------------|----|---------------------|
| Type of electric connection | | 3 conductors AWG 12 |
| Rated current In | Α | 25 |
| Min. busbar thickness | mm | 5 |
| Max. busbar thickness | mm | 10 |
| Width of the adapter | mm | 90 |
| Rail width | mm | 35 |
| Busbar distance | mm | 60 |

Approvals

| • • | |
|--------------------------------------|---|
| Product Standards | UL 508A; CSA-C22.2 No. 14; IEC60439-1; CE marking |
| UL File No. | E300273 |
| UL Category Control No. | NMTR; NMTR7 |
| North America Certification | UL listed, certified by UL for use in Canada |
| Specially designed for North America | No |
| Max. Voltage Rating | 600 V AC |

Dimensions

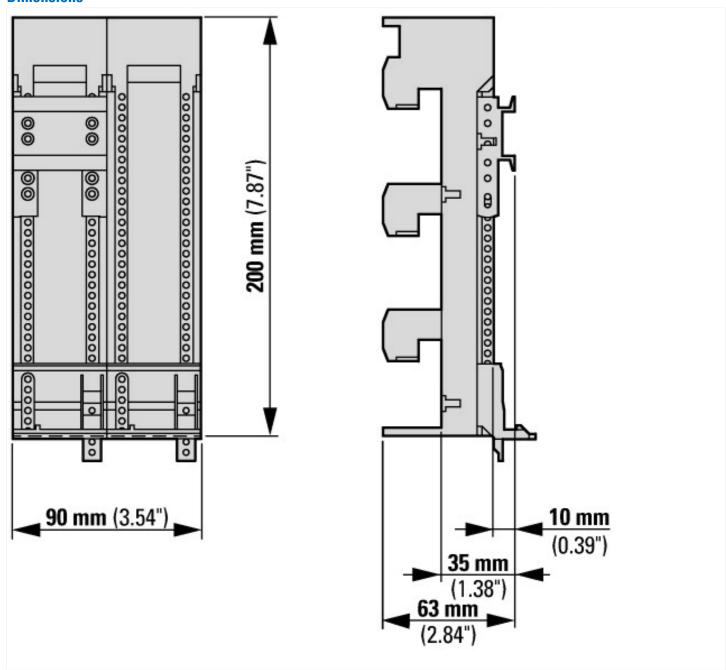

Assets (links)

Declaration of CE Conformity 00003119

Instruction Leaflets

IL03402015Z2018_05

Additional product information (links)

| Additional product information (mike) | | |
|--|--|--|
| IL03402015Z (AWA1210-2324) Busbar adapter | | |
| IL03402015Z (AWA1210-2324) Busbar adapter | ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL03402015Z2018_05.pdf | |
| Motor starters and "Special Purpose Ratings" for the North American market | http://www.eaton.eu/ecm/groups/public/@pub/@europe/@electrical/documents/content/pct_3258146.pdf | |
| Busbar Component Adapters for modern Industrial control panels | http://www.moeller.net/binary/ver_techpapers/ver960en.pdf | |