

Carrier, +label

**Part no.** Q25TS-10  
**Catalog No.** 046186  
**Alternate Catalog No.** Q25TS-10

0

Similar to illustration

## Delivery program

|   |  |  |                               |
|---|--|--|-------------------------------|
| Product range                                 |  |  | Accessories                   |
| Basic function accessories                    |  |  | Label mount with insert label |
| Single unit/Complete unit                     |  |  | Single unit                   |
| <b>Colour</b>                                 |  |  |                               |
|   |  |  | 0                             |
| Connection to SmartWire-DT                    |  |  | no                            |
| <b>Notes</b>                                  |  |  |                               |
| Custom labelling of insert labels on request. |  |  |                               |
| Delivery time: 4 weeks.                       |  |  |                               |

## Design verification as per IEC/EN 61439

|  |            |    |  |
|--|------------|----|--|
| Technical data for design verification   |            |    |  |
| Rated operational current for specified heat dissipation   | $I_n$      | A  | 0  |
| Heat dissipation per pole, current-dependent   | $P_{vid}$  | W  | 0  |
| Equipment heat dissipation, current-dependent  | $P_{vid}$  | W  | 0  |
| Static heat dissipation, non-current-dependent   | $P_{vs}$   | W  | 0  |
| Heat dissipation capacity  | $P_{diss}$ | W  | 0  |
| Operating ambient temperature min.   |            | °C | -25  |
| Operating ambient temperature max.   |            | °C | 60   |
| IEC/EN 61439 design verification   |            |    |  |
| 10.2 Strength of materials and parts   |            |    |  |
| 10.2.2 Corrosion resistance  |            |    | Meets the product standard's requirements.                         |
| 10.2.3.1 Verification of thermal stability of enclosures   |            |    | Meets the product standard's requirements.                         |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat   |            |    | Meets the product standard's requirements.                         |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects |            |    | Meets the product standard's requirements.                         |
| 10.2.4 Resistance to ultra-violet (UV) radiation   |            |    | Please enquire   |
| 10.2.5 Lifting   |            |    | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.6 Mechanical impact   |            |    | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.7 Inscriptions  |            |    | Meets the product standard's requirements.                         |
| 10.3 Degree of protection of ASSEMBLIES  |            |    | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.4 Clearances and creepage distances   |            |    | Meets the product standard's requirements.                         |
| 10.5 Protection against electric shock   |            |    | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.6 Incorporation of switching devices and components   |            |    | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.7 Internal electrical circuits and connections  |            |    | Is the panel builder's responsibility.                             |
| 10.8 Connections for external conductors   |            |    | Is the panel builder's responsibility.                             |
| 10.9 Insulation properties   |            |    |  |
| 10.9.2 Power-frequency electric strength   |            |    | Is the panel builder's responsibility.                             |
| 10.9.3 Impulse withstand voltage   |            |    | Is the panel builder's responsibility.                             |

|  |  |  |  |
|--|--|--|--|
| 10.9.4 Testing of enclosures made of insulating material |  |  | Is the panel builder's responsibility.   |
| 10.10 Temperature rise                                   |  |  | Not applicable.  |
| 10.11 Short-circuit rating                               |  |  | Is the panel builder's responsibility. The specifications for the switchgear must be observed.           |
| 10.12 Electromagnetic compatibility                      |  |  | Is the panel builder's responsibility. The specifications for the switchgear must be observed.           |
| 10.13 Mechanical function                                |  |  | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed. |


## Technical data ETIM 7.0

|  |  |    |               |
|--|--|----|---------------|
| Low-voltage industrial components (EG000017) / Text plate for control circuit devices (EC000624)   |  |    |               |
| Electric engineering, automation, process control engineering / Low-voltage switch technology / Command and alarm device / Identification plate for command devices (ecI@ss10.0.1-27-37-12-25 [AKF043014]) |  |    |               |
| Imprint  |  |    | Other         |
| Imprint ISO symbols  |  |    | "Symbol ""0"" |
| Colour   |  |    | Black         |
| Shape  |  |    | Rectangular   |
| Width  |  | mm | 25            |
| Height   |  | mm | 38            |
| Outer diameter   |  | mm | 0             |

## Approvals

|                             |  |  |                                   |
|-----------------------------|--|--|-----------------------------------|
| North America Certification |  |  | UL/CSA certification not required |
|-----------------------------|--|--|-----------------------------------|

## Dimensions

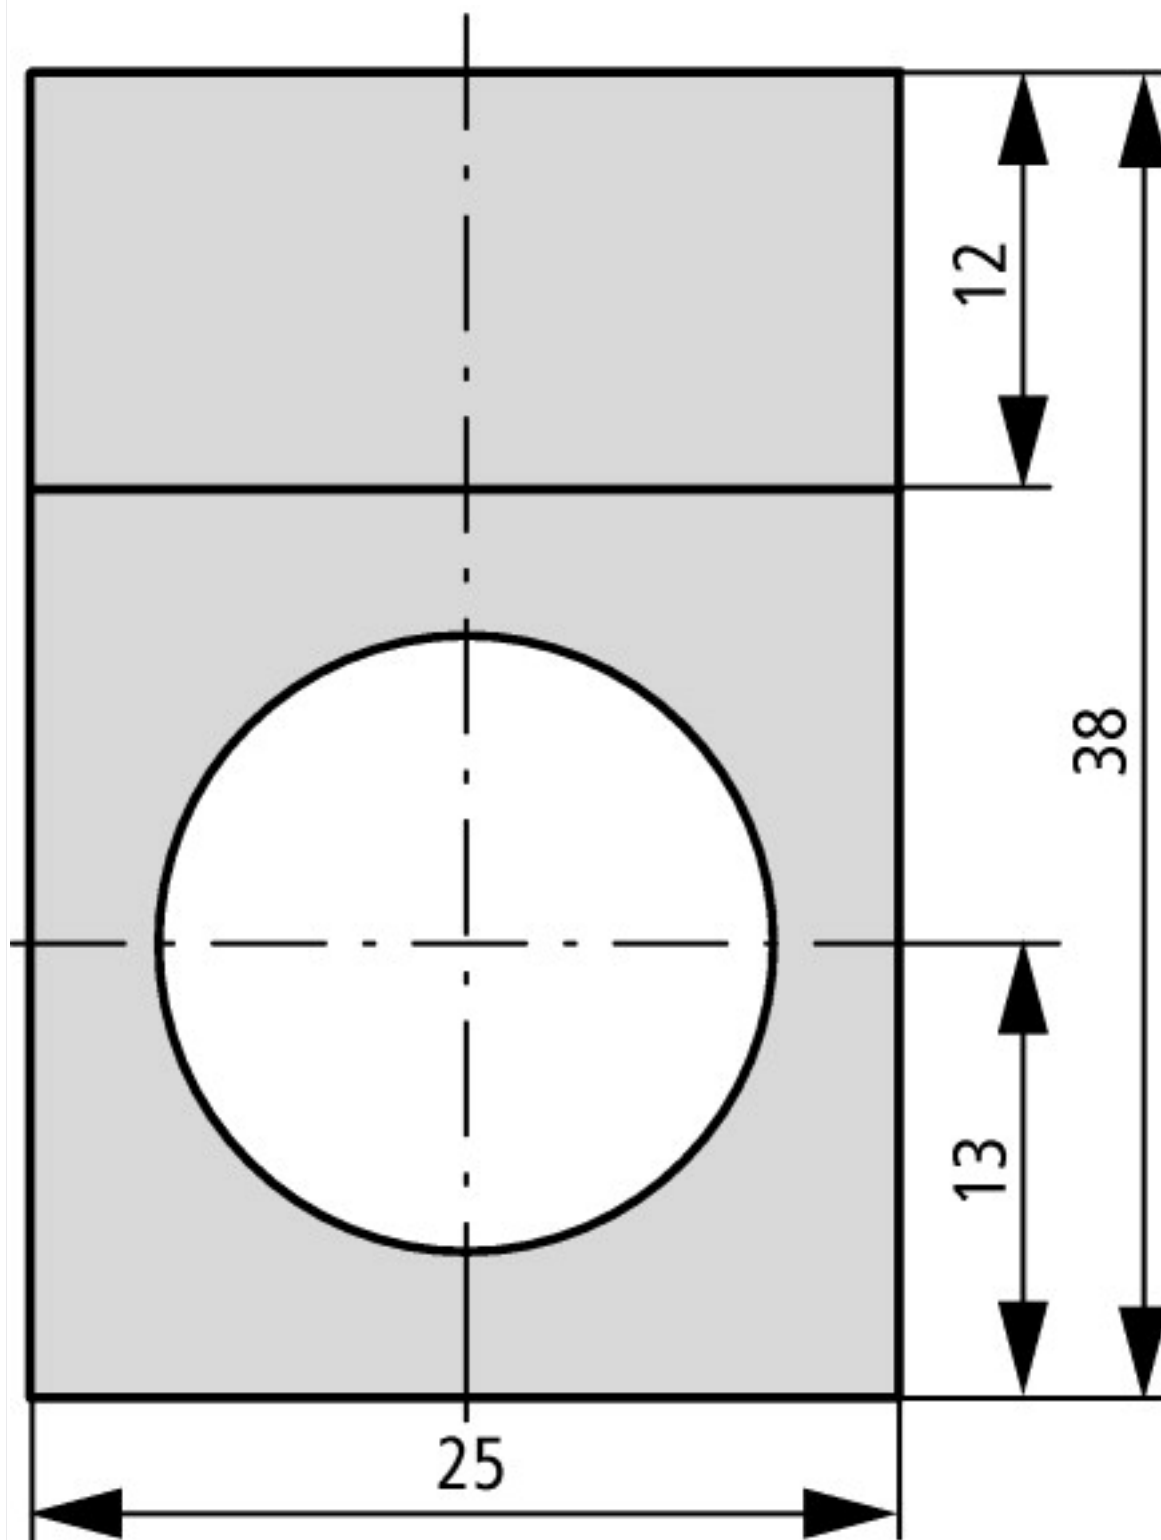

## Assets (links)

### Declaration of CE Conformity

00002898

### Instruction Leaflets

IL04716016Z2018\_05

## Additional product information (links)

### IL04716016Z (AWA1160-1429) Mounting of components

IL04716016Z (AWA1160-1429) Mounting of components

[ftp://ftp.moeller.net/DOCUMENTATION/AWA\\_INSTRUCTIONS/IL04716016Z2018\\_05.pdf](ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL04716016Z2018_05.pdf)