

**Busbar adapter, 45 mm, 25 A, DIN rail: 1**

**Part no.** BBA0-25  
**Catalog No.** 101451  
**Alternate Catalog No.** BBA0-25  
**EL-Nummer (Norway)** 0002465046

**Delivery program**

|   |       |          |   |
|---|-------|----------|---|
| Accessories   |       |          | Busbar adapters   |
|   |       |          | For fitting to flat Cu-busbars with 60 mm between busbar centres, suitable for 5 mm and 10 mm busbar thickness<br>Rated operational current 25 A<br>For DOL Starter |
| For use with  |       |          | Busbar adapter PKZ0, PKE  |
| Rated operational voltage   | $U_e$ | V        | 690   |
| Rated operational current   | $I_e$ | A        | 25  |
| Terminal capacity   |       |          | AWG 12<br>(4 mm <sup>2</sup> )  |
| Adapter width   |       | mm       | 45  |
| Adapter length  |       | mm       | 200   |
| DIN rail  |       | Quantity | 1   |
| Adapter width   |       | mm       | 45  |
| For use with  |       |          | PKZM0, PKE + DILM7<br>PKZM0, PKE + DILM9<br>PKZM0, PKE + DILM12<br>PKZM0, PKE + DILM15<br>MSC-D(M)-0,25-M7... - MSC-D(M)-16-M15...                                  |
| <b>Notes</b> Use in combination with individual components PKZM0, PKE, and DILM DOL set PKZM0-XDM12.<br>Completely mounted and tested combination with MSC-D... |       |          |   |

**Design verification as per IEC/EN 61439**

|  |            |    |  |
|--|------------|----|--|
| Technical data for design verification   |            |    |  |
| Rated operational current for specified heat dissipation   | $I_n$      | A  | 25   |
| Heat dissipation per pole, current-dependent   | $P_{vid}$  | W  | 0  |
| Equipment heat dissipation, current-dependent  | $P_{vid}$  | W  | 1.9  |
| Static heat dissipation, non-current-dependent   | $P_{vs}$   | W  | 0  |
| Heat dissipation capacity  | $P_{diss}$ | W  | 0  |
| Operating ambient temperature min.   |            | °C | -25  |
| Operating ambient temperature max.   |            | °C | 55   |
| IEC/EN 61439 design verification   |            |    |  |
| 10.2 Strength of materials and parts   |            |    |  |
| 10.2.2 Corrosion resistance  |            |    | Meets the product standard's requirements.                         |
| 10.2.3.1 Verification of thermal stability of enclosures   |            |    | Meets the product standard's requirements.                         |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat   |            |    | Meets the product standard's requirements.                         |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects |            |    | Meets the product standard's requirements.                         |
| 10.2.4 Resistance to ultra-violet (UV) radiation   |            |    | Meets the product standard's requirements.                         |
| 10.2.5 Lifting   |            |    | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.6 Mechanical impact   |            |    | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.7 Inscriptions  |            |    | Meets the product standard's requirements.                         |
| 10.3 Degree of protection of ASSEMBLIES  |            |    | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.4 Clearances and creepage distances   |            |    | Meets the product standard's requirements.                         |
| 10.5 Protection against electric shock   |            |    | Does not apply, since the entire switchgear needs to be evaluated. |

|  |  |  |  |
|--|--|--|--|
| 10.6 Incorporation of switching devices and components   |  |  | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.7 Internal electrical circuits and connections        |  |  | Is the panel builder's responsibility.   |
| 10.8 Connections for external conductors                 |  |  | Is the panel builder's responsibility.   |
| 10.9 Insulation properties                               |  |  |  |
| 10.9.2 Power-frequency electric strength                 |  |  | Is the panel builder's responsibility.   |
| 10.9.3 Impulse withstand voltage                         |  |  | Is the panel builder's responsibility.   |
| 10.9.4 Testing of enclosures made of insulating material |  |  | Is the panel builder's responsibility.   |
| 10.10 Temperature rise                                   |  |  | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating                               |  |  | Is the panel builder's responsibility. The specifications for the switchgear must be observed.                                   |
| 10.12 Electromagnetic compatibility                      |  |  | Is the panel builder's responsibility. The specifications for the switchgear must be observed.                                   |
| 10.13 Mechanical function                                |  |  | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.                         |


## Technical data ETIM 7.0

|  |  |    |                     |
|--|--|----|---------------------|
| Low-voltage industrial components (EG000017) / Busbar adapter (EC001531)   |  |    |                     |
| Electric engineering, automation, process control engineering / Low-voltage switch technology / Busbar trunking system (LV circuitry) / Busbar adapter (low-voltage switching technology) (ecI@ss10.0.1-27-37-03-04 [ACN951011]) |  |    |                     |
| Mounting rail armament   |  |    | 1 mounting rail     |
| Type of electric connection  |  |    | 3 conductors AWG 12 |
| Rated current I <sub>n</sub>   |  | A  | 25                  |
| Min. busbar thickness  |  | mm | 5                   |
| Max. busbar thickness  |  | mm | 10                  |
| Width of the adapter   |  | mm | 45                  |
| Rail width   |  | mm | 35                  |
| Busbar distance  |  | mm | 60                  |

## Approvals

|                                      |  |  |   |
|--------------------------------------|--|--|---|
| Product Standards                    |  |  | UL 508A; CSA-C22.2 No. 14; IEC60439-1; CE marking |
| UL File No.                          |  |  | E300273   |
| UL Category Control No.              |  |  | NMTR; NMTR7                                       |
| North America Certification          |  |  | UL listed, certified by UL for use in Canada      |
| Specially designed for North America |  |  | No  |
| Max. Voltage Rating                  |  |  | 600 V AC  |

## Dimensions

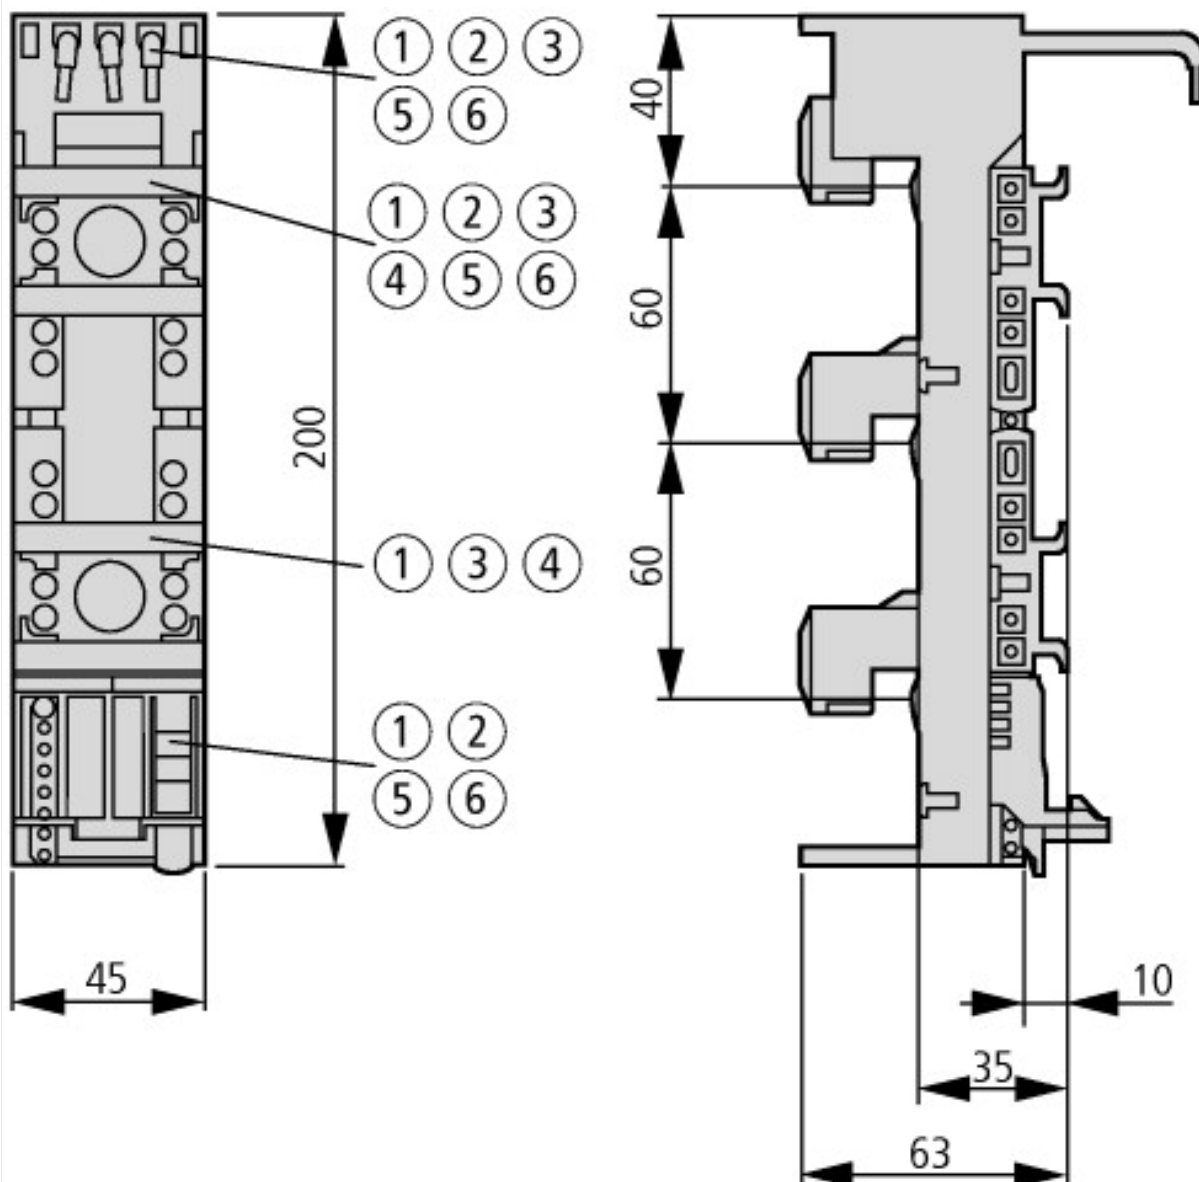

- |                 |              |
|-----------------|--------------|
| ① BBA0-32/2TS-C | ④ BBA0/2TS-L |
| ② BBA0-25/2TS   | ⑤ BBA0-25    |
| ③ BBA0C-16      | ⑥ BBA0-32    |

## Assets (links)

### Declaration of CE Conformity

00002841

### Instruction Leaflets

IL03402015Z2018\_05

## Additional product information (links)

### IL03402015Z (AWA1210-2324) Busbar adapter

IL03402015Z (AWA1210-2324) Busbar adapter

[ftp://ftp.moeller.net/DOCUMENTATION/AWA\\_INSTRUCTIONS/IL03402015Z2018\\_05.pdf](ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL03402015Z2018_05.pdf)

Motor starters and "Special Purpose Ratings" for the North American market

[http://www.eaton.eu/ecm/groups/public/@pub/@europe/@electrical/documents/content/pct\\_3258146.pdf](http://www.eaton.eu/ecm/groups/public/@pub/@europe/@electrical/documents/content/pct_3258146.pdf)

Busbar Component Adapters for modern Industrial control panels

[http://www.moeller.net/binary/ver\\_techpapers/ver960en.pdf](http://www.moeller.net/binary/ver_techpapers/ver960en.pdf)